

August 24, 2022

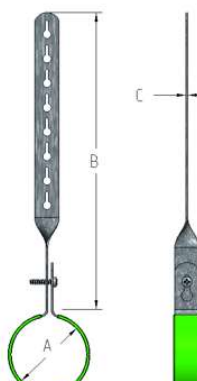
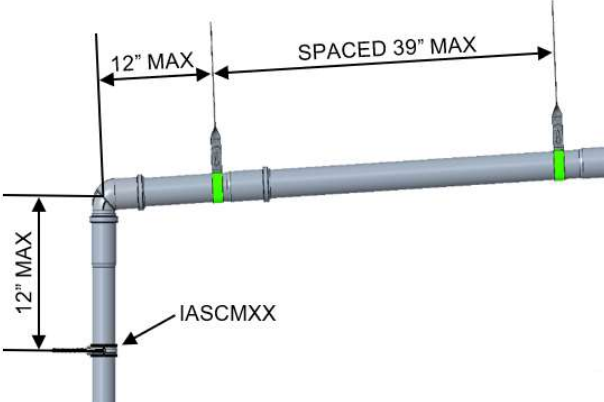
Centrotherm Eco Systems

www.centrotherm.us.com • 518.434.3400


RE: Support Clamps

To Whom it may concern,

Centrotherm Eco System requires clam shell style support clamps with min. 5/16" threaded rod to properly support InnoFlue Vent. In an effort to provide additional supporting options, Centrotherm has tested/reviewed the following hanger clamps and has deemed them to satisfy the requirements as long as the criteria below is met.

<p>HANGER SPECIFICATIONS:</p> <p>DIMENSION "A" = FULL CONTACT WITH INNOFLUE 2", 3", OR 4" VENT</p> <p>DIMENSION "B" = 12" MAX</p> <p>DIMENSION "C" = 16 GAUGE STEEL MIN.</p> 	<p>INSTALLATION REQUIREMENTS:</p> <ol style="list-style-type: none"> 1. FOLLOW INNOFLUE INSTALLATION INSTRUCTIONS. 2. HANGER SHALL ONLY BE USED TO SUPPORT HORIZONTAL RUNS. INSTALL HANGERS NO MORE THAN 39" APART. 3. SUPPORT DIRECTIONAL CHANGES WITHIN 12" USING A HANGER AND SUPPORT CLAMP (IASCMXX) AS SHOWN BELOW.
<p>REFERENCE HANGER PART NUMBERS:</p> <p>IASH02, IASH03, IASH04</p>	<p>TYPICAL INSTALLATION:</p> 
<p>NOTE: This specification supersedes previous approval for 2" hangers provided on January 21, 2022.</p>	

Sincerely,



Kevin Shaw
Engineering Manager
Centrotherm Eco Systems